



Figure 2-3 Greenidge Unit 4 circulating water pump A.

## 2.2 OPERATION

Greenidge has operated intermittently over the last 3 years with annual capacity factors of 18% in 2017, 20% in 2018, and 6% in 2019. Generation has typically been higher in summer months, although the winter of 2017-2018 was also a period of relatively high output (Figure 2-4).

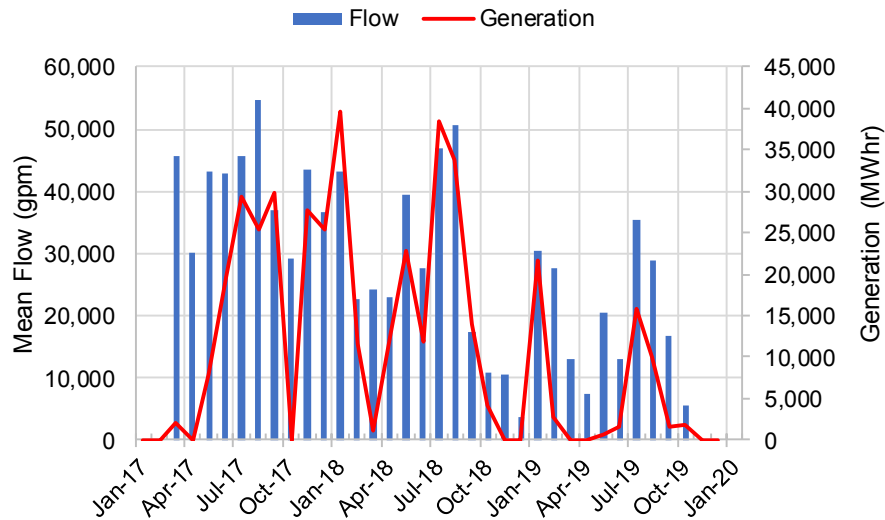


Figure 2-4 Mean monthly flow (gpm) and monthly generation (MWhr) at Greenidge Generation, 2017-2019.